


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:230.0V I:0.659A P:150.0W PF:0.990 Freq:50.01Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:24573x1 lm		
NAME: HB74-150-5080-H00217	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 163.82 lm/W			
MODEL	/	I _{max} (cd)	13025	S/MH (C0/180)	1.19
NOMINAL POWER (W)	/	LOR (%)	100.0	S/MH (C90/270)	1.19
RATED VOLTAGE (V)	/	TOTAL FLUX (lm)	24573	η UP,DN (C0-180)	0.0,50.0
NOMINAL FLUX (lm)	24573	CIE CLASS	DIRECT	η UP,DN (C180-360)	0.0,50.0
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	1.25
TEST VOLTAGE (V)	/	η down (%)	100.0	CIBSE SHR MAX	1.25

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

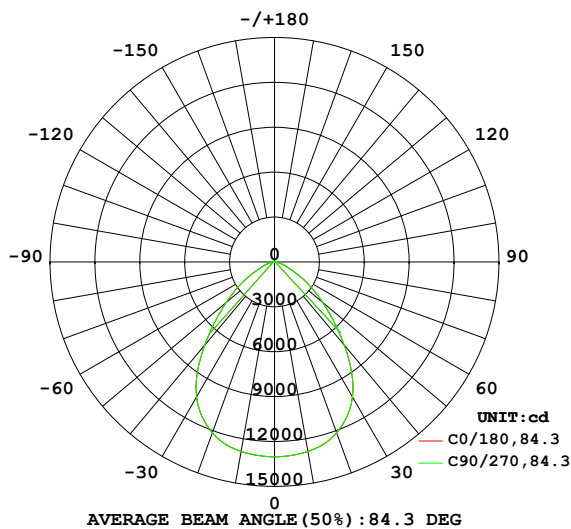

PLANAR ISOLUX DIAGRAM (UNIT:lx)

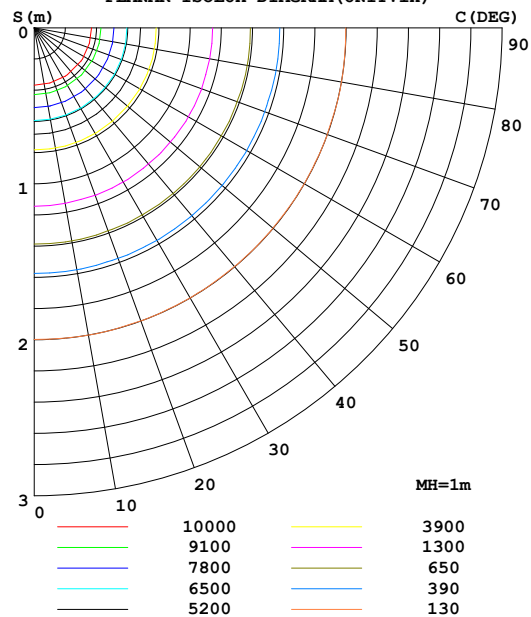

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:ZZX
Test Date:2023-09-22

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4559]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1286	1286	1286	1286	1286	1286	1286	1286	0- 10	1235	1235	5.03,5.03
20	1214	1214	1214	1214	1214	1214	1214	1214	10- 20	3555	4790	19.5,19.5
30	1042	1042	1042	1042	1042	1042	1042	1042	20- 30	5242	10032	40.8,40.8
40	725.1	725.1	725.1	725.1	725.1	725.1	725.1	725.1	30- 40	5568	15600	63.5,63.5
50	421.3	421.3	421.3	421.3	421.3	421.3	421.3	421.3	40- 50	4336	19936	81.1,81.1
60	205.0	205.0	205.0	205.0	205.0	205.0	205.0	205.0	50- 60	2740	22676	92.3,92.3
70	76.87	76.87	76.87	76.87	76.87	76.87	76.87	76.87	60- 70	1278	23955	97.5,97.5
80	25.16	25.16	25.16	25.16	25.16	25.16	25.16	25.16	70- 80	505.1	24460	99.5,99.5
90	0.1777	0.1777	0.1777	0.1777	0.1777	0.1777	0.1777	0.1777	80- 90	113.3	24573	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:X10cd									UNIT:lm		

Conical surface Flux(90deg): 17968 lm

%lum = 73.1%

%lamp = 73.1%

Conical surface Flux(120deg): 22676 lm


%lum = 92.3%

%lamp = 92.3%

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:ZZX
Test Date:2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4559]
Remarks:

LUMINANCE LIMITATION CURVES

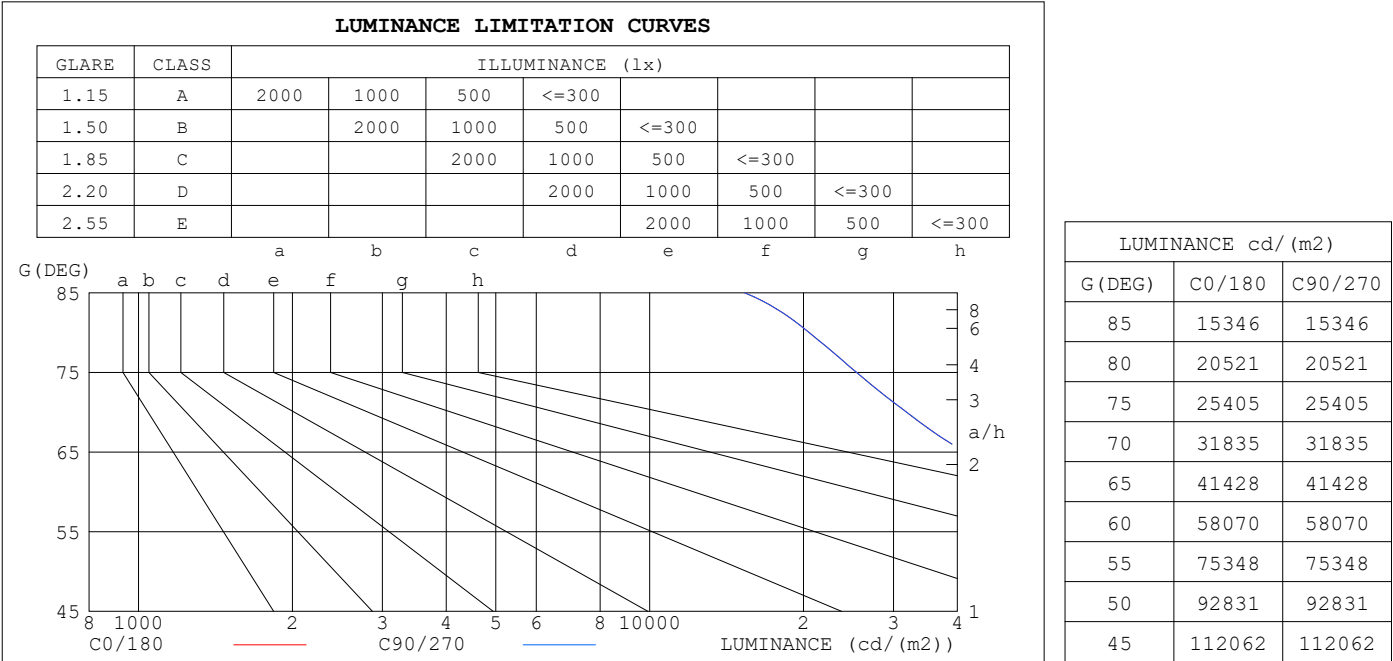


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:ZZX
Test Date:2023-09-22

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4559]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.08	1.04	1.01	1.05	1.02	.00	1.01	.99	.96	.97	.95	.94	.94	.92	.91	.89
2.0	.97	.91	.87	.95	.90	.86	.91	.87	.84	.88	.85	.82	.85	.83	.80	.78
3.0	.87	.80	.75	.86	.79	.74	.83	.77	.73	.80	.76	.72	.78	.74	.71	.69
4.0	.79	.71	.66	.78	.71	.65	.75	.69	.64	.73	.68	.64	.71	.67	.63	.61
5.0	.72	.64	.58	.71	.63	.58	.69	.62	.57	.67	.61	.57	.65	.60	.56	.54
6.0	.65	.58	.52	.65	.57	.52	.63	.56	.51	.61	.55	.51	.60	.55	.51	.49
7.0	.60	.52	.47	.59	.52	.47	.58	.51	.46	.56	.51	.46	.55	.50	.46	.44
8.0	.55	.48	.42	.55	.47	.42	.53	.47	.42	.52	.46	.42	.51	.46	.42	.40
9.0	.51	.44	.39	.51	.43	.39	.50	.43	.38	.48	.43	.38	.48	.42	.38	.36
10.0	.48	.40	.36	.47	.40	.35	.46	.40	.35	.45	.39	.35	.44	.39	.35	.33

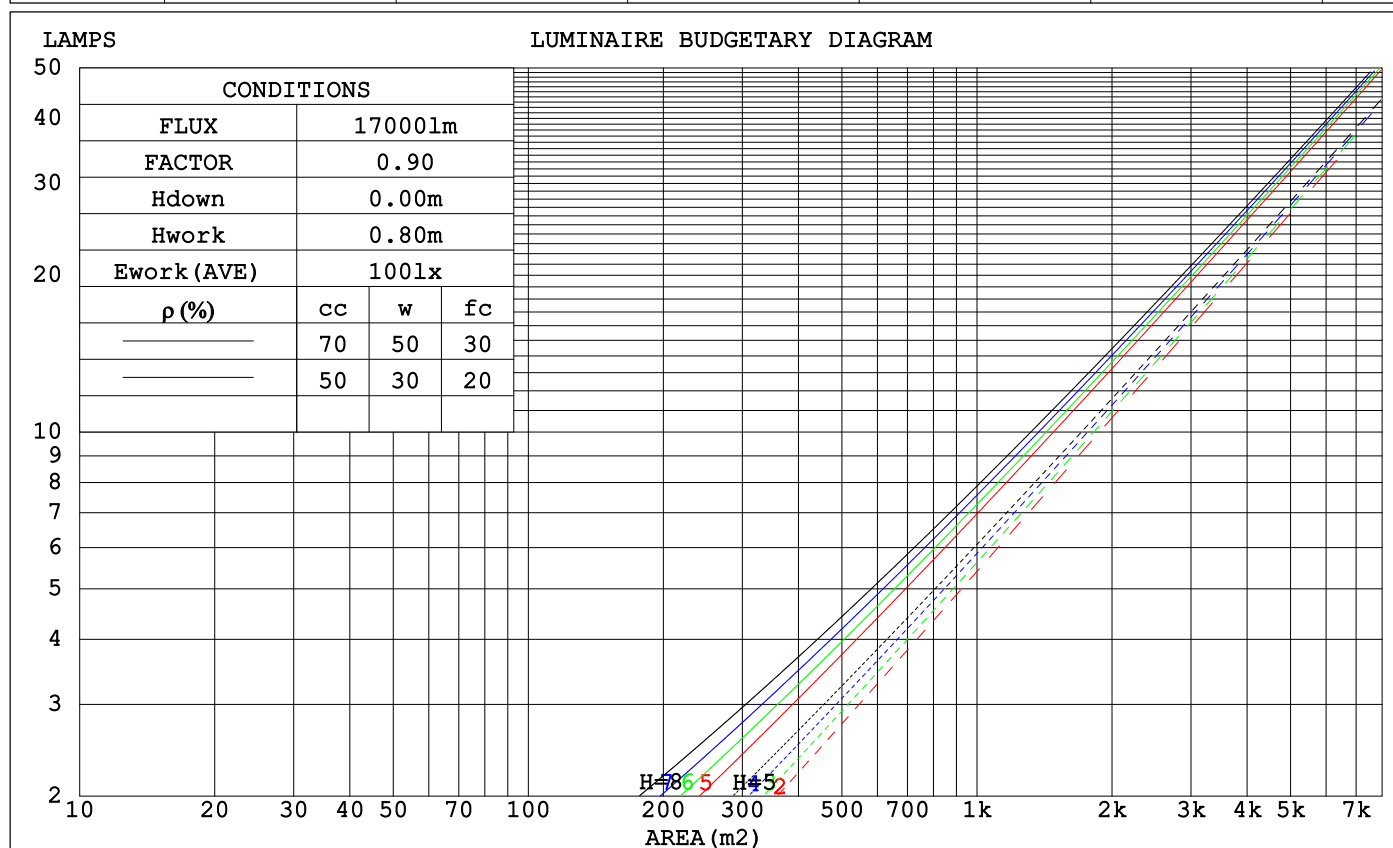

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:ZZX
Test Date:2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4559]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)									
0.0																
1.0	.240	.136	.043	.233	.133	.042	.220	.126	.040	.208	.120	.039	.197	.114	.037	
2.0	.232	.127	.039	.226	.125	.038	.215	.120	.037	.205	.115	.036	.195	.111	.035	
3.0	.221	.117	.035	.215	.115	.035	.206	.111	.034	.197	.108	.033	.188	.104	.032	
4.0	.208	.108	.032	.204	.107	.031	.195	.103	.031	.187	.100	.030	.180	.098	.030	
5.0	.196	.100	.029	.192	.099	.029	.185	.096	.028	.177	.094	.028	.171	.091	.027	
6.0	.185	.093	.027	.181	.092	.026	.175	.089	.026	.168	.087	.026	.162	.085	.025	
7.0	.174	.086	.024	.171	.085	.024	.165	.084	.024	.160	.082	.024	.154	.080	.024	
8.0	.165	.081	.023	.162	.080	.023	.157	.078	.022	.152	.077	.022	.147	.075	.022	
9.0	.156	.076	.021	.154	.075	.021	.149	.074	.021	.144	.072	.021	.140	.071	.021	
10.0	.148	.071	.020	.146	.070	.020	.141	.069	.020	.137	.068	.019	.133	.067	.019	

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.175	.157	.140	.150	.135	.120	.103	.093	.083	.059	.054	.048	.019	.017	.016	
2.0	.164	.132	.105	.141	.114	.091	.096	.079	.063	.056	.046	.037	.018	.015	.012	
3.0	.155	.114	.081	.133	.098	.070	.091	.068	.049	.053	.040	.029	.017	.013	.010	
4.0	.147	.100	.064	.126	.086	.056	.087	.060	.039	.050	.035	.023	.016	.011	.008	
5.0	.139	.089	.052	.120	.077	.045	.082	.054	.032	.048	.032	.019	.015	.010	.006	
6.0	.133	.081	.043	.114	.070	.038	.079	.049	.027	.046	.029	.016	.015	.009	.005	
7.0	.126	.073	.037	.109	.064	.032	.075	.045	.023	.044	.026	.013	.014	.009	.004	
8.0	.120	.068	.031	.104	.059	.027	.072	.041	.019	.042	.024	.012	.013	.008	.004	
9.0	.115	.063	.027	.099	.054	.024	.069	.038	.017	.040	.023	.010	.013	.007	.003	
10.0	.110	.058	.024	.095	.051	.021	.066	.036	.015	.038	.021	.009	.012	.007	.003	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3°C
 Operators:ZZX
 Test Date:2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
 Humidity:65.0%
 Test Distance:26.000m [K=0.4559]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	25.4	26.8	25.7	27.1	27.4	25.4	26.8	25.7	27.1	27.4
3H	26.0	27.2	26.4	27.5	27.9	26.0	27.2	26.4	27.5	27.9
4H	26.2	27.3	26.6	27.7	28.0	26.2	27.3	26.6	27.7	28.0
6H	26.3	27.3	26.7	27.7	28.1	26.3	27.3	26.7	27.7	28.1
8H	26.3	27.3	26.7	27.7	28.1	26.3	27.3	26.7	27.7	28.1
12H	26.3	27.2	26.7	27.6	28.0	26.3	27.2	26.7	27.6	28.0
4H 2H	25.6	26.7	26.0	27.1	27.4	25.6	26.7	26.0	27.1	27.4
3H	26.3	27.3	26.7	27.7	28.1	26.3	27.3	26.7	27.7	28.1
4H	26.6	27.4	27.0	27.8	28.3	26.6	27.4	27.0	27.8	28.3
6H	26.7	27.5	27.2	27.9	28.4	26.7	27.5	27.2	27.9	28.4
8H	26.8	27.5	27.2	27.9	28.4	26.8	27.5	27.2	27.9	28.4
12H	26.8	27.4	27.3	27.9	28.3	26.8	27.4	27.3	27.9	28.3
8H 4H	26.6	27.3	27.1	27.7	28.2	26.6	27.3	27.1	27.7	28.2
6H	26.8	27.4	27.3	27.9	28.4	26.8	27.4	27.3	27.9	28.4
8H	26.9	27.4	27.4	27.9	28.4	26.9	27.4	27.4	27.9	28.4
12H	26.9	27.4	27.5	27.9	28.4	26.9	27.4	27.5	27.9	28.4
12H 4H	26.6	27.2	27.1	27.7	28.1	26.6	27.2	27.1	27.7	28.1
6H	26.8	27.3	27.3	27.8	28.3	26.8	27.3	27.3	27.8	28.3
8H	26.9	27.4	27.4	27.8	28.4	26.9	27.4	27.4	27.8	28.4
CIE190: 2010										

CIE190: 2010
Area: 0.0706 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:ZZX
Test Date:2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4559]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	68	59	53	68	58	53	67	58	53	47
0.80	78	69	63	77	68	63	76	68	62	57
1.00	86	77	71	85	77	71	83	77	71	65
1.25	92	84	79	91	83	78	89	82	77	71
1.50	96	89	84	95	88	83	92	86	82	76
2.00	102	95	90	100	94	90	97	92	88	82
2.50	104	99	94	103	97	93	99	95	91	84
3.00	107	102	98	105	100	97	101	98	94	87
4.00	110	106	102	108	104	101	104	101	98	90
5.00	112	108	105	109	106	103	105	103	100	92
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004						Suspended			SHRNOM = 1.25	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators: ZZX
 Test Date: 2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
 Humidity: 65.0%
 Test Distance: 26.000m [K=0.4559]
 Remarks:


ISOCANDELA DIAGRAM

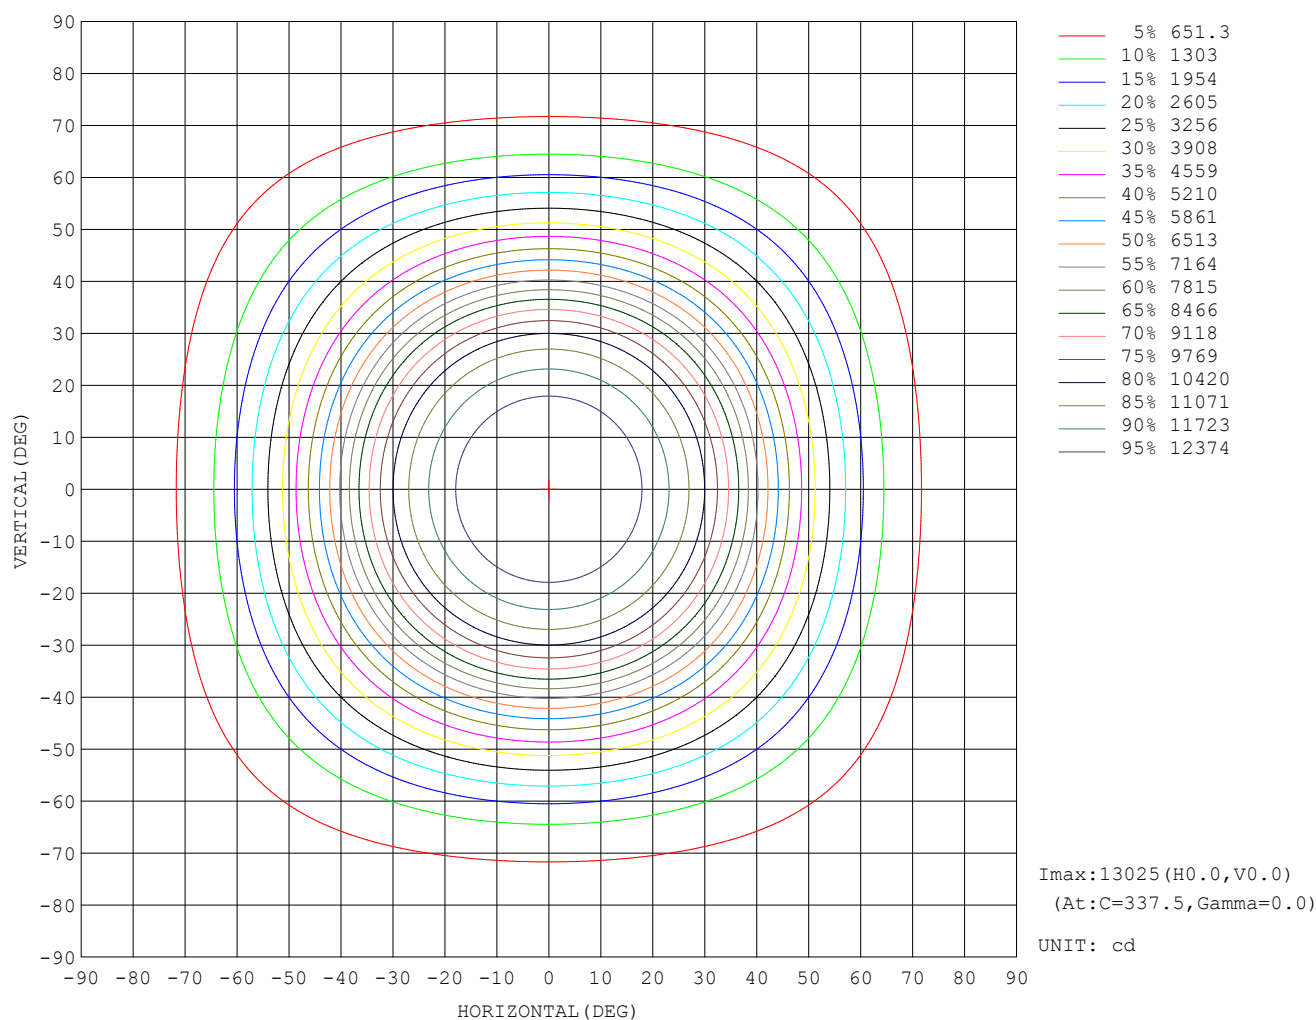

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:ZZX
Test Date:2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4559]
Remarks:

AAI Figure

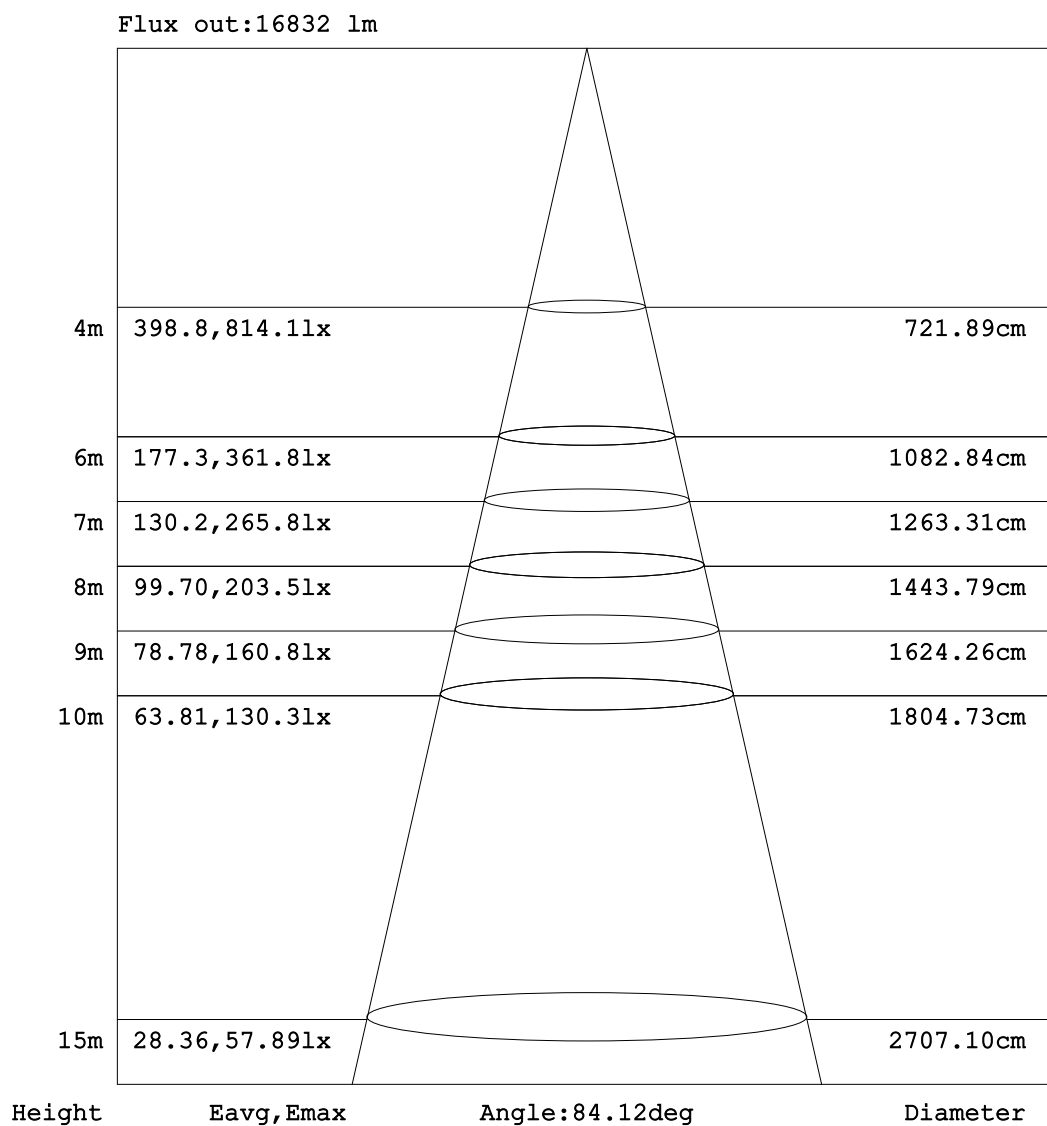


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:ZZX
Test Date:2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4559]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


ISOLUX DIAGRAM

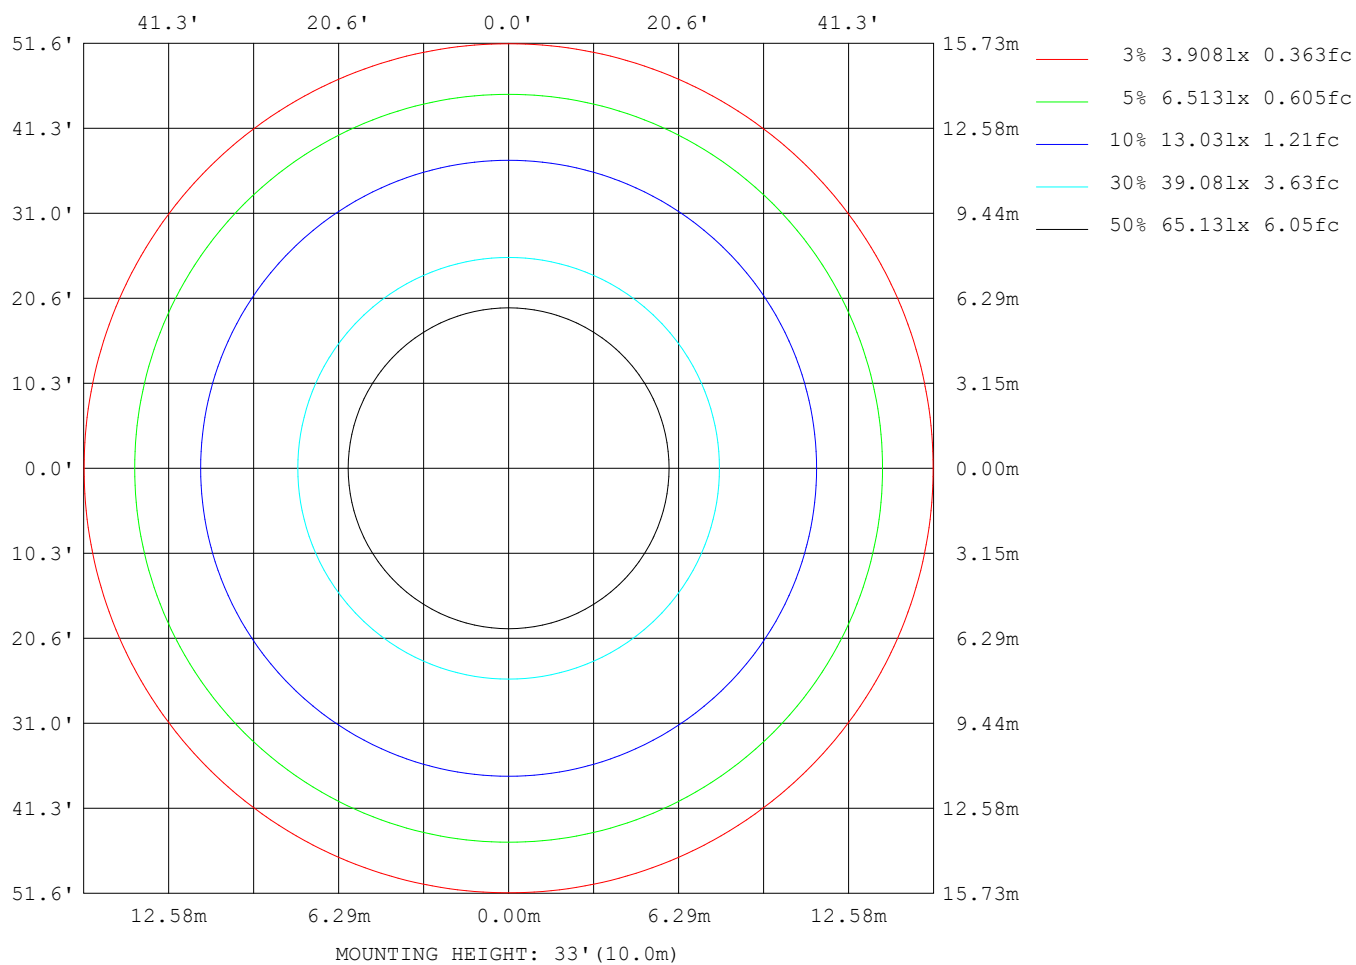

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZX
Test Date: 2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4559]
Remarks:

Planar Illuminance Curve

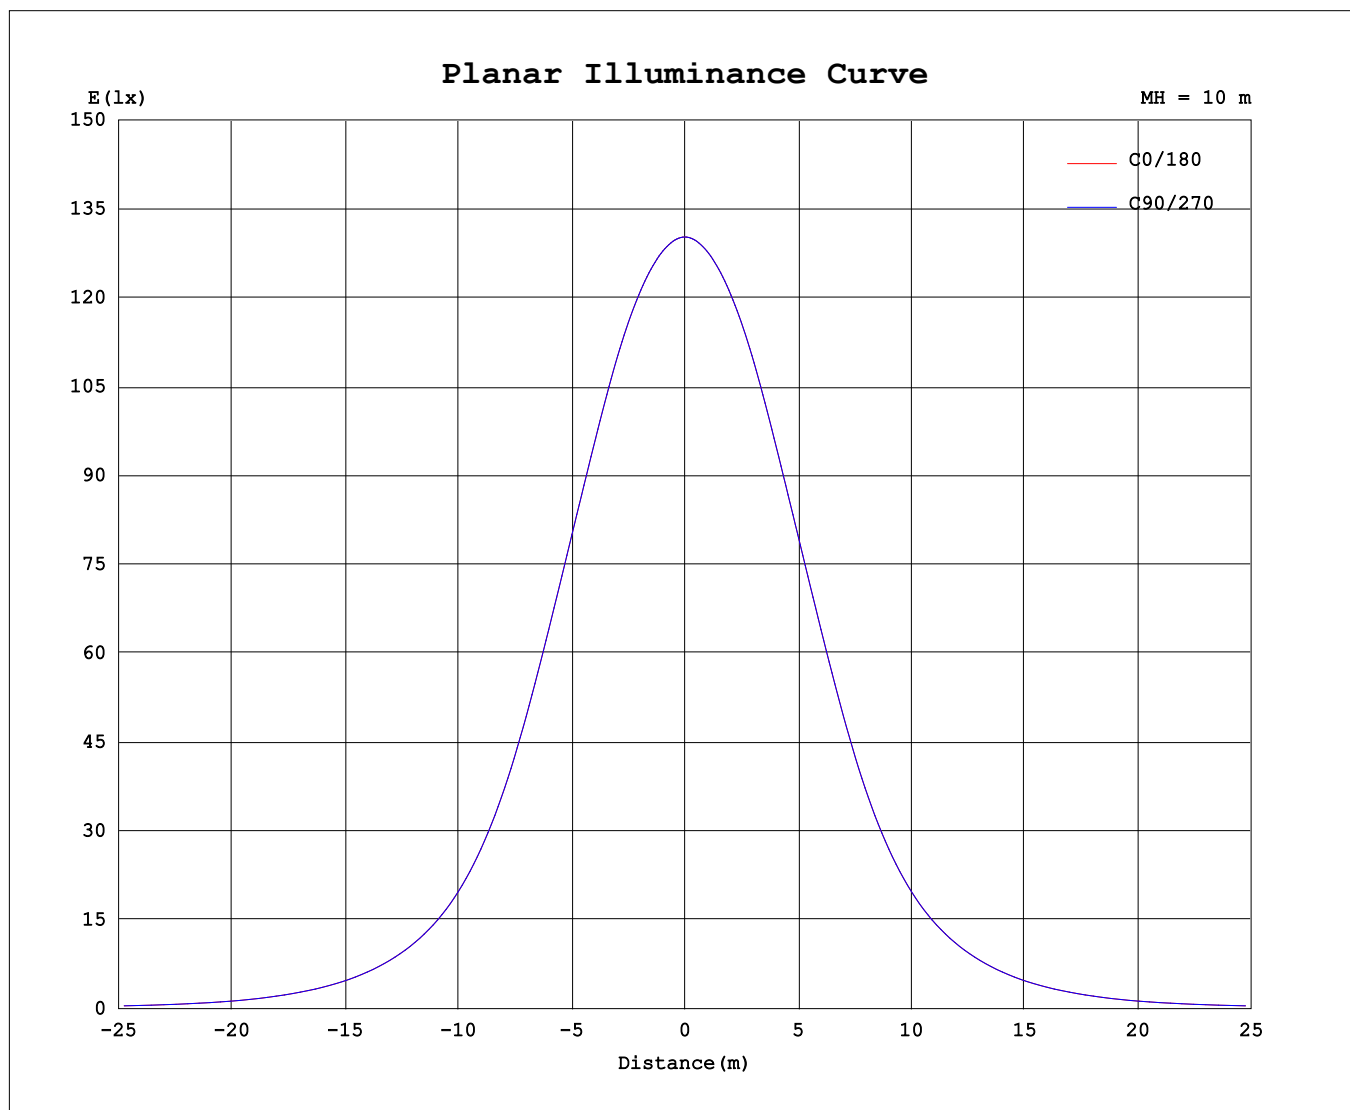

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZX
Test Date: 2023-09-22

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4559]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

UNIT: X10cd

[illegible]

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZX
Test Date: 2023-09-22

```

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4559]
Remarks:

```