


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:230.0V I:5.228A P:1200.0W PF:0.998 Freq:50.00Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:170464x1 lm		
NAME: SP04-1K2-5770-F04015X	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 142.05 lm/W			
MODEL	/	Imax (cd)	1429671	S/MH (C0/180)	0.29
NOMINAL POWER (W)	/	LOR (%)	100.0	S/MH (C90/270)	0.26
RATED VOLTAGE (V)	/	TOTAL FLUX (lm)	170464	η UP, DN (C0-180)	0.0, 48.1
NOMINAL FLUX (lm)	170464	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.0, 51.9
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.00
TEST VOLTAGE (V)	/	η down (%)	100.0	CIBSE SHR MAX	0.30

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

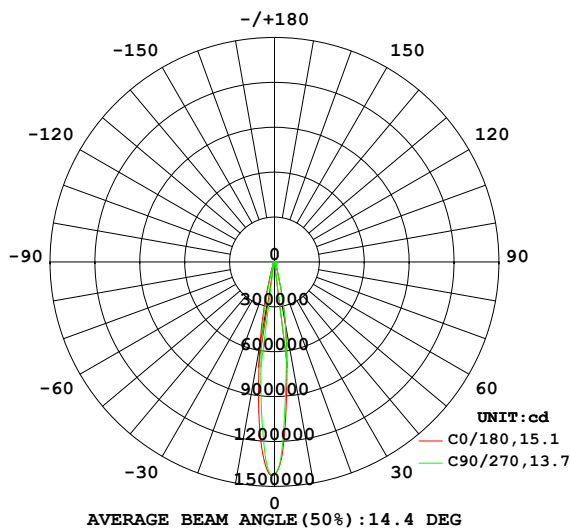

PLANAR ISOLUX DIAGRAM (UNIT: lx)

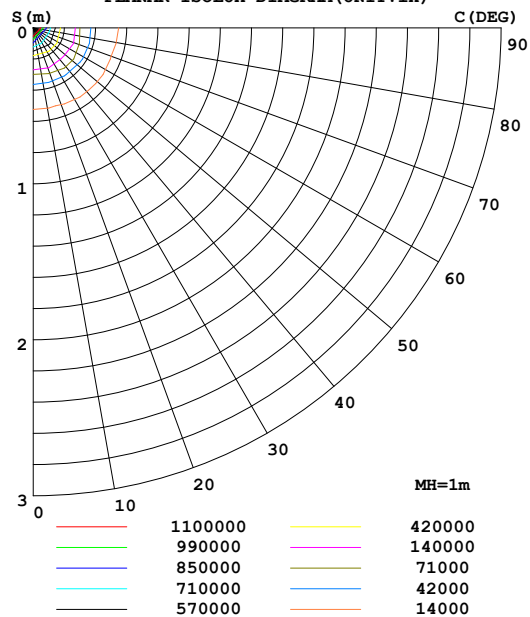

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZX
Test Date: 2023-12-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4621]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum,lamp
10	415.6	452.0	419.8	528.1	557.3	561.3	475.0	499.5	0- 10	77986	77986	45.7,45.7
20	43.22	53.55	47.69	71.40	60.01	79.50	51.19	59.29	10- 20	50227	128213	75.2,75.2
30	15.45	16.99	18.10	19.36	18.08	19.93	20.11	17.79	20- 30	14182	142395	83.5,83.5
40	9.802	9.952	11.26	10.75	10.47	10.78	12.20	10.47	30- 40	8347	150741	88.4,88.4
50	7.214	7.222	8.237	7.740	7.580	7.851	8.571	7.718	40- 50	6994	157735	92.5,92.5
60	4.803	5.332	5.707	5.718	5.193	5.733	5.658	5.645	50- 60	5988	163723	96,96
70	2.730	3.373	3.172	3.744	3.067	3.772	3.093	3.547	60- 70	4320	168043	98.6,98.6
80	0.7775	0.8515	0.8581	1.037	0.9753	1.096	0.8678	0.9635	70- 80	2100	170143	99.8,99.8
90	0.0044	0.0040	0.0034	0.0068	0.0120	0.0099	0.0059	0.0051	80- 90	321.4	170464	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:X1000cd									UNIT:lm		

Conical surface Flux(90deg): 1.5434e+005 lm

%lum = 90.5%

%lamp = 90.5%

Conical surface Flux(120deg): 1.6372e+005 lm


%lum = 96.0%

%lamp = 96.0%

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:ZZX
Test Date:2023-12-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4621]
Remarks:

LUMINANCE LIMITATION CURVES

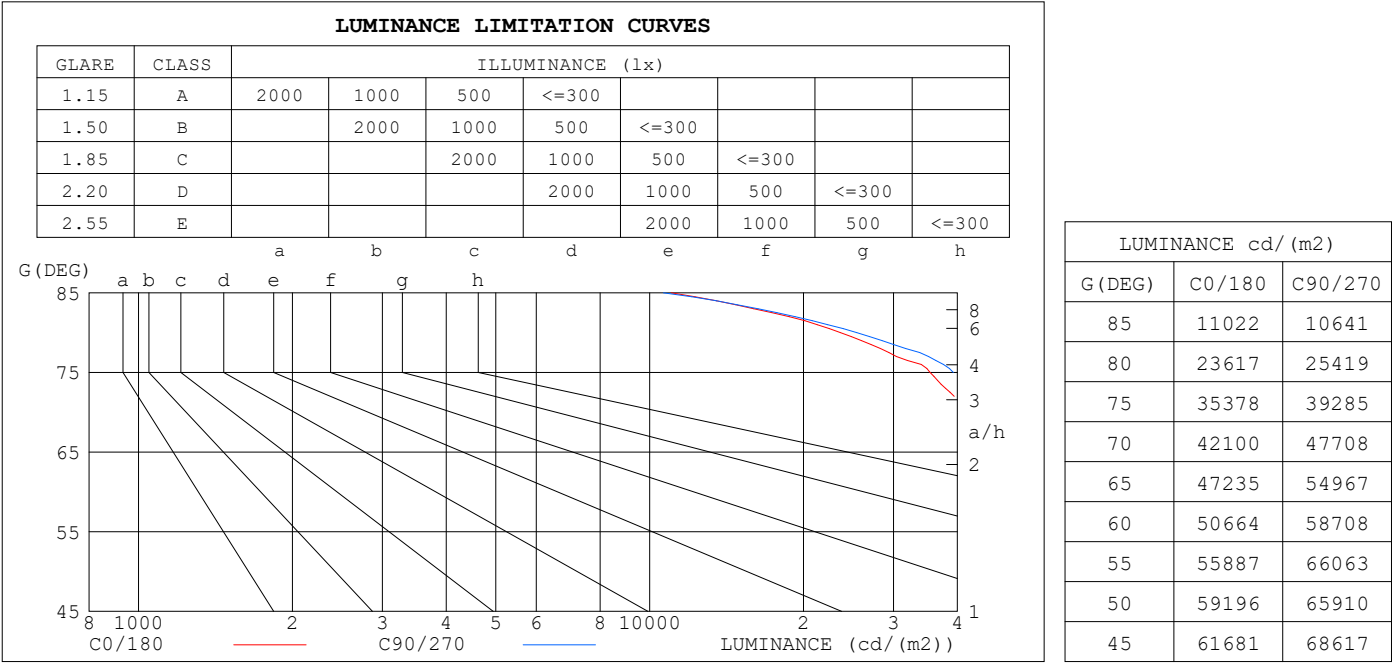


C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:ZZX
Test Date:2023-12-01

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4621]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.12	1.10	1.08	1.10	1.08	1.06	1.06	1.04	1.03	1.02	1.01	.00	.99	.98	.97	.95
2.0	1.06	1.02	.00	1.04	1.01	.98	1.01	.98	.96	.98	.96	.94	.95	.94	.92	.91
3.0	1.01	.97	.93	.99	.96	.93	.97	.94	.91	.94	.92	.90	.92	.90	.88	.87
4.0	.96	.92	.89	.95	.91	.88	.93	.90	.87	.91	.88	.86	.90	.87	.85	.84
5.0	.93	.88	.85	.92	.88	.84	.90	.86	.84	.89	.85	.83	.87	.84	.82	.81
6.0	.89	.85	.82	.89	.84	.81	.87	.84	.81	.86	.83	.80	.85	.82	.80	.79
7.0	.87	.82	.79	.86	.82	.79	.85	.81	.78	.84	.80	.78	.83	.80	.78	.77
8.0	.84	.80	.77	.84	.79	.77	.83	.79	.76	.82	.78	.76	.81	.78	.76	.75
9.0	.82	.78	.75	.81	.77	.75	.81	.77	.74	.80	.77	.74	.79	.76	.74	.73
10.0	.80	.76	.73	.80	.76	.73	.79	.75	.73	.78	.75	.73	.78	.75	.72	.71

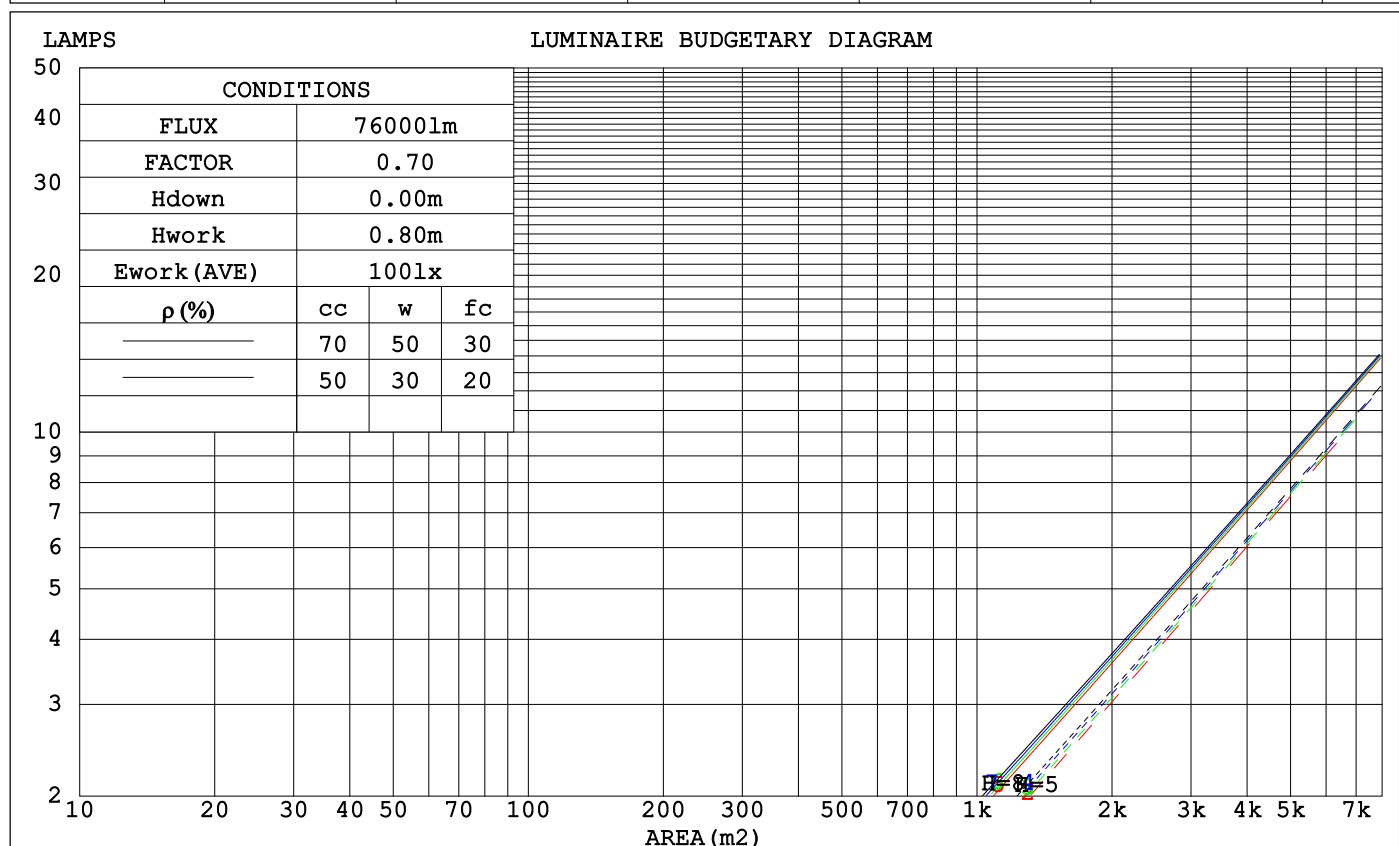

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:ZZX
Test Date:2023-12-01

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4621]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0	
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)										
0.0																	
1.0	.155	.088	.028	.149	.085	.027	.136	.078	.025	.125	.072	.023	.114	.066	.021		
2.0	.144	.079	.024	.139	.076	.024	.128	.071	.022	.119	.067	.021	.110	.062	.020		
3.0	.134	.071	.021	.129	.069	.021	.120	.065	.020	.112	.061	.019	.105	.058	.018		
4.0	.124	.064	.019	.120	.063	.019	.113	.060	.018	.106	.057	.017	.099	.054	.016		
5.0	.115	.059	.017	.112	.057	.017	.106	.055	.016	.100	.053	.016	.094	.050	.015		
6.0	.108	.054	.015	.105	.053	.015	.099	.051	.015	.094	.049	.014	.090	.047	.014		
7.0	.101	.050	.014	.098	.049	.014	.094	.047	.014	.089	.046	.013	.085	.044	.013		
8.0	.095	.046	.013	.093	.046	.013	.089	.044	.013	.085	.043	.012	.081	.042	.012		
9.0	.090	.043	.012	.088	.043	.012	.084	.042	.012	.081	.041	.012	.078	.039	.011		
10.0	.085	.041	.011	.084	.040	.011	.080	.039	.011	.077	.038	.011	.074	.037	.011		

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.158	.147	.145	.135	.126	.099	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.153	.133	.116	.131	.114	.100	.090	.079	.070	.052	.046	.041	.017	.015	.013	
3.0	.138	.113	.094	.118	.098	.081	.081	.068	.057	.047	.040	.034	.015	.013	.011	
4.0	.126	.098	.077	.108	.085	.067	.074	.059	.047	.043	.035	.028	.014	.011	.009	
5.0	.115	.086	.064	.099	.074	.056	.068	.052	.039	.040	.031	.023	.013	.010	.008	
6.0	.106	.076	.054	.091	.066	.047	.063	.046	.034	.037	.027	.020	.012	.009	.007	
7.0	.098	.068	.047	.085	.059	.041	.059	.041	.029	.034	.024	.017	.011	.008	.006	
8.0	.092	.061	.040	.079	.053	.035	.055	.037	.025	.032	.022	.015	.010	.007	.005	
9.0	.086	.055	.035	.074	.048	.031	.051	.034	.022	.030	.020	.013	.010	.007	.004	
10.0	.080	.051	.031	.069	.044	.027	.048	.031	.019	.028	.018	.011	.009	.006	.004	

C Range: 0 - 360DEG
 C Interval: 10.0DEG
 Test Speed: HIGH
 Temperature:25.3°C
 Operators:ZZX
 Test Date:2023-12-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
 Humidity:65.0%
 Test Distance:26.000m [K=0.4621]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	21.1	22.1	21.5	22.5	22.8	21.4	22.5	21.8	22.8	23.1
3H	22.6	23.5	23.0	23.9	24.2	23.0	24.0	23.4	24.3	24.7
4H	23.1	23.9	23.5	24.3	24.7	23.5	24.4	23.9	24.7	25.1
6H	23.3	24.0	23.7	24.4	24.8	23.7	24.5	24.1	24.9	25.3
8H	23.3	24.0	23.7	24.4	24.8	23.7	24.5	24.1	24.8	25.3
12H	23.2	23.9	23.7	24.3	24.8	23.7	24.4	24.1	24.8	25.2
4H 2H	21.8	22.7	22.2	23.0	23.4	22.2	23.0	22.6	23.4	23.8
3H	23.4	24.1	23.9	24.6	25.0	23.8	24.5	24.2	24.9	25.3
4H	23.9	24.6	24.4	25.0	25.4	24.3	25.0	24.8	25.4	25.8
6H	24.2	24.7	24.7	25.2	25.7	24.6	25.1	25.1	25.6	26.1
8H	24.2	24.7	24.7	25.2	25.6	24.6	25.1	25.1	25.6	26.0
12H	24.2	24.6	24.7	25.1	25.6	24.6	25.0	25.1	25.5	26.0
8H 4H	24.1	24.6	24.6	25.1	25.5	24.5	25.0	25.0	25.5	26.0
6H	24.4	24.8	24.9	25.3	25.8	24.8	25.2	25.3	25.7	26.2
8H	24.4	24.8	25.0	25.3	25.8	24.9	25.2	25.4	25.7	26.2
12H	24.4	24.7	25.0	25.2	25.8	24.9	25.2	25.4	25.7	26.2
12H 4H	24.1	24.5	24.6	25.0	25.5	24.5	24.9	25.0	25.4	25.9
6H	24.4	24.7	24.9	25.2	25.8	24.8	25.2	25.4	25.7	26.2
8H	24.4	24.8	25.0	25.2	25.8	24.9	25.2	25.4	25.7	26.3
CIE190: 2010										

CIE190: 2010
Area: 0.194 m2

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:ZZX
Test Date:2023-12-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4621]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	84	78	73	84	77	73	83	77	73	69
0.80	92	86	81	91	85	81	90	85	81	77
1.00	97	91	87	96	90	86	94	90	86	81
1.25	101	95	91	100	95	91	98	93	90	86
1.50	104	99	95	103	98	94	100	96	93	88
2.00	107	102	99	106	101	98	103	99	97	91
2.50	109	105	101	107	103	100	104	101	99	92
3.00	111	107	104	109	105	103	105	103	101	94
4.00	113	110	107	111	108	106	107	105	103	96
5.00	114	112	110	112	110	108	108	107	105	97
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 10.0DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators: ZZX
 Test Date: 2023-12-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
 Humidity: 65.0%
 Test Distance: 26.000m [K=0.4621]
 Remarks:


ISOCANDELA DIAGRAM

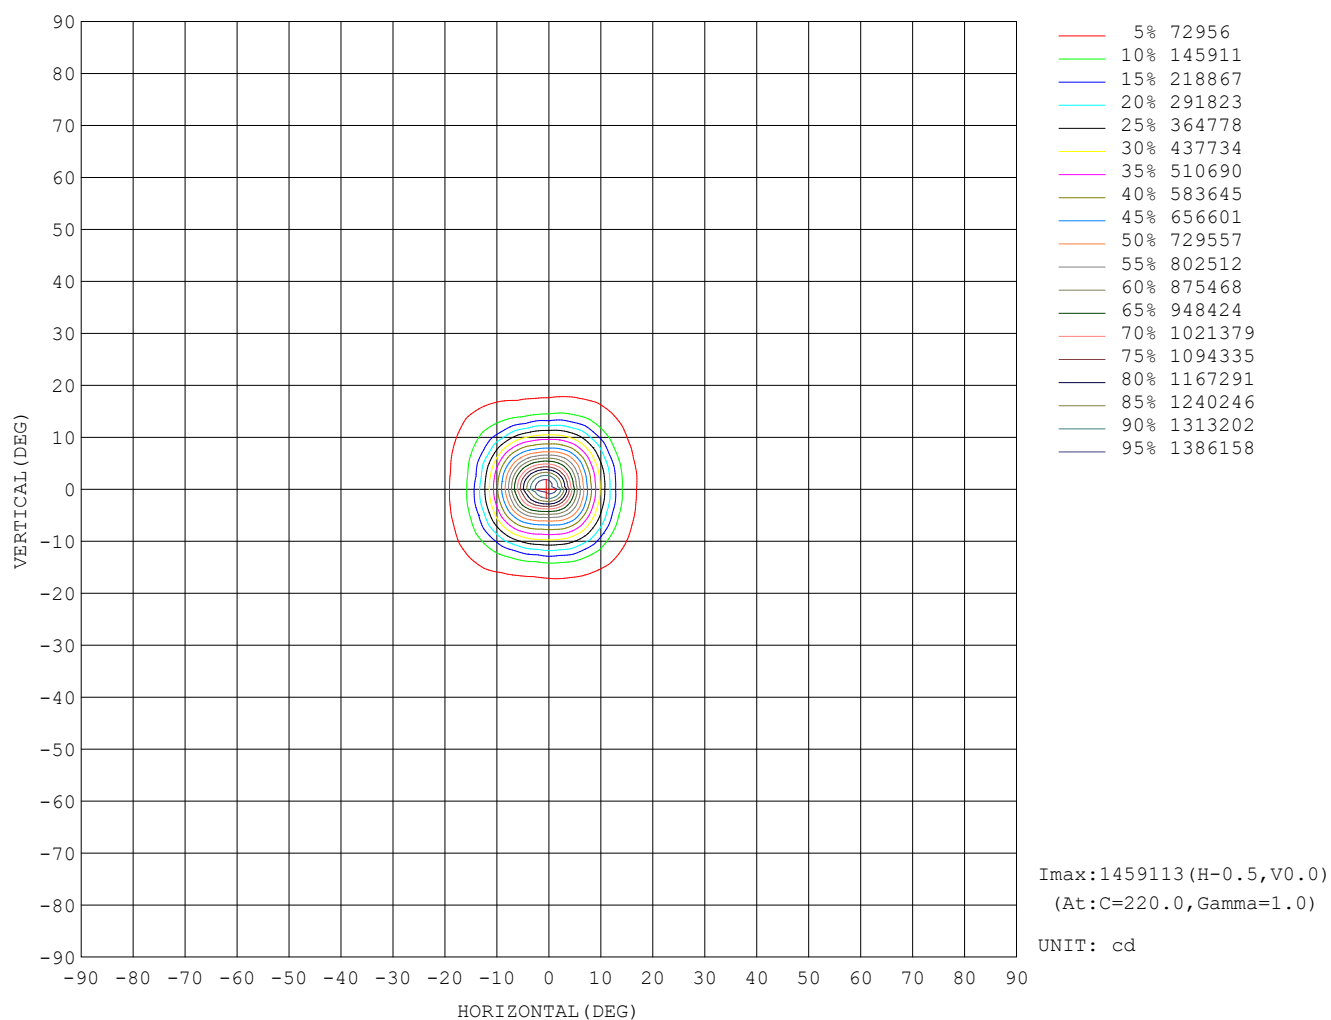

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZX
Test Date: 2023-12-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4621]
Remarks:

AAI Figure

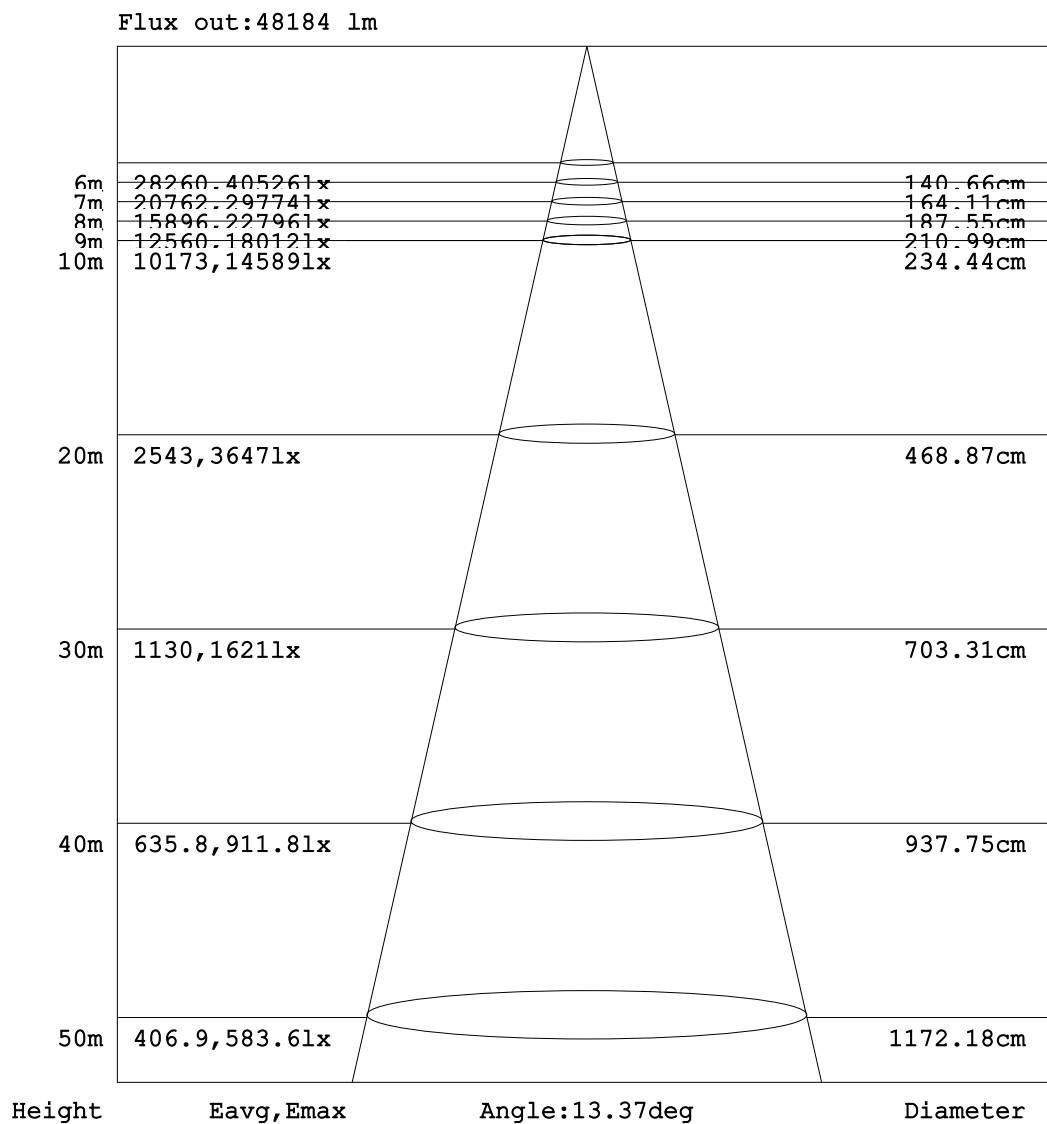


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZXX
Test Date: 2023-12-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4621]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


ISOLUX DIAGRAM

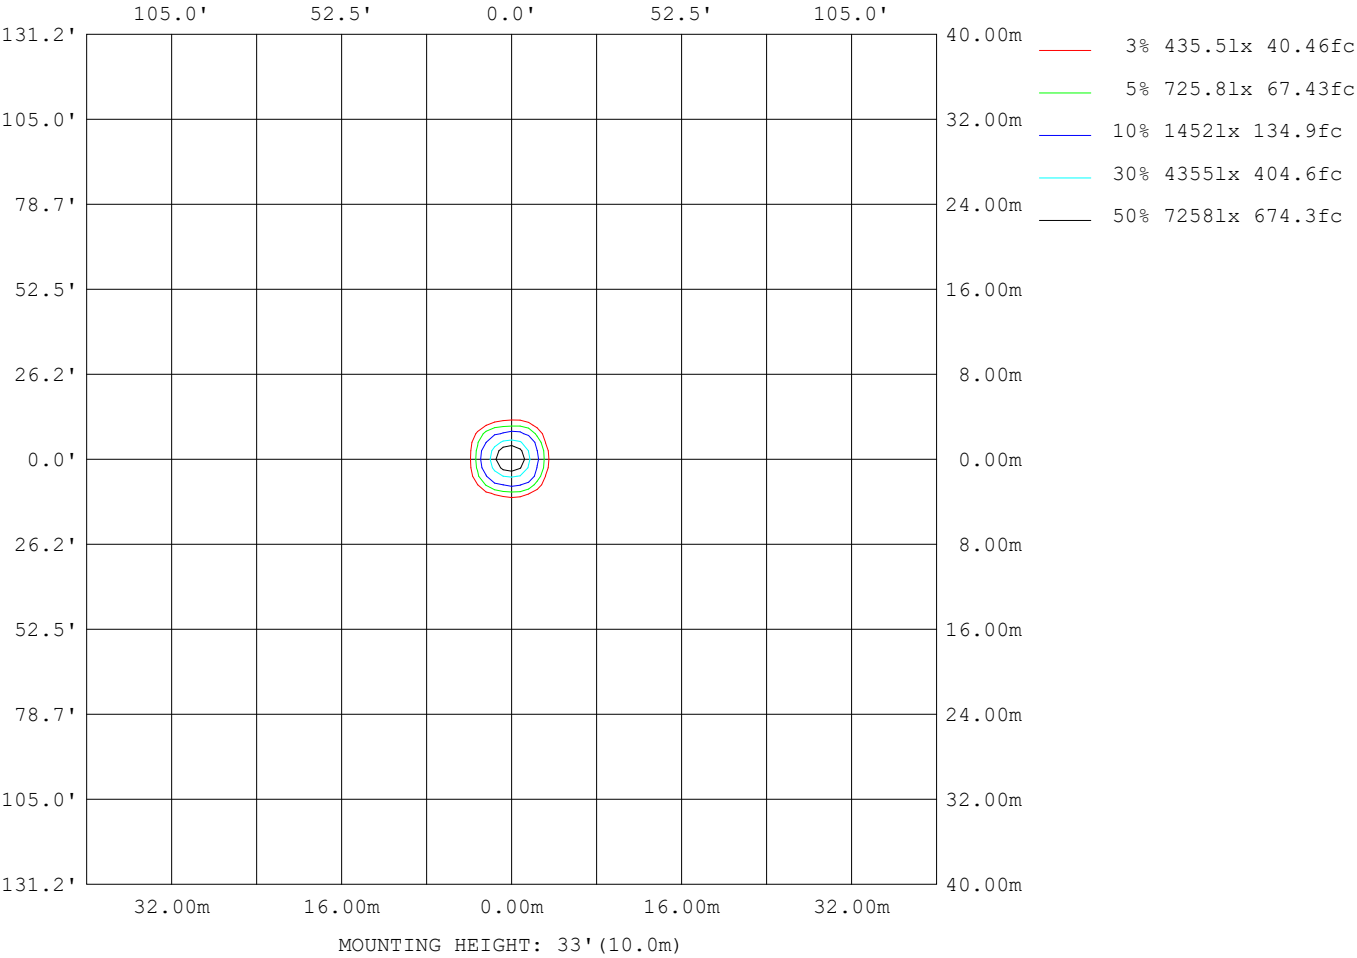

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZX
Test Date: 2023-12-01

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4621]
Remarks:

Planar Illuminance Curve

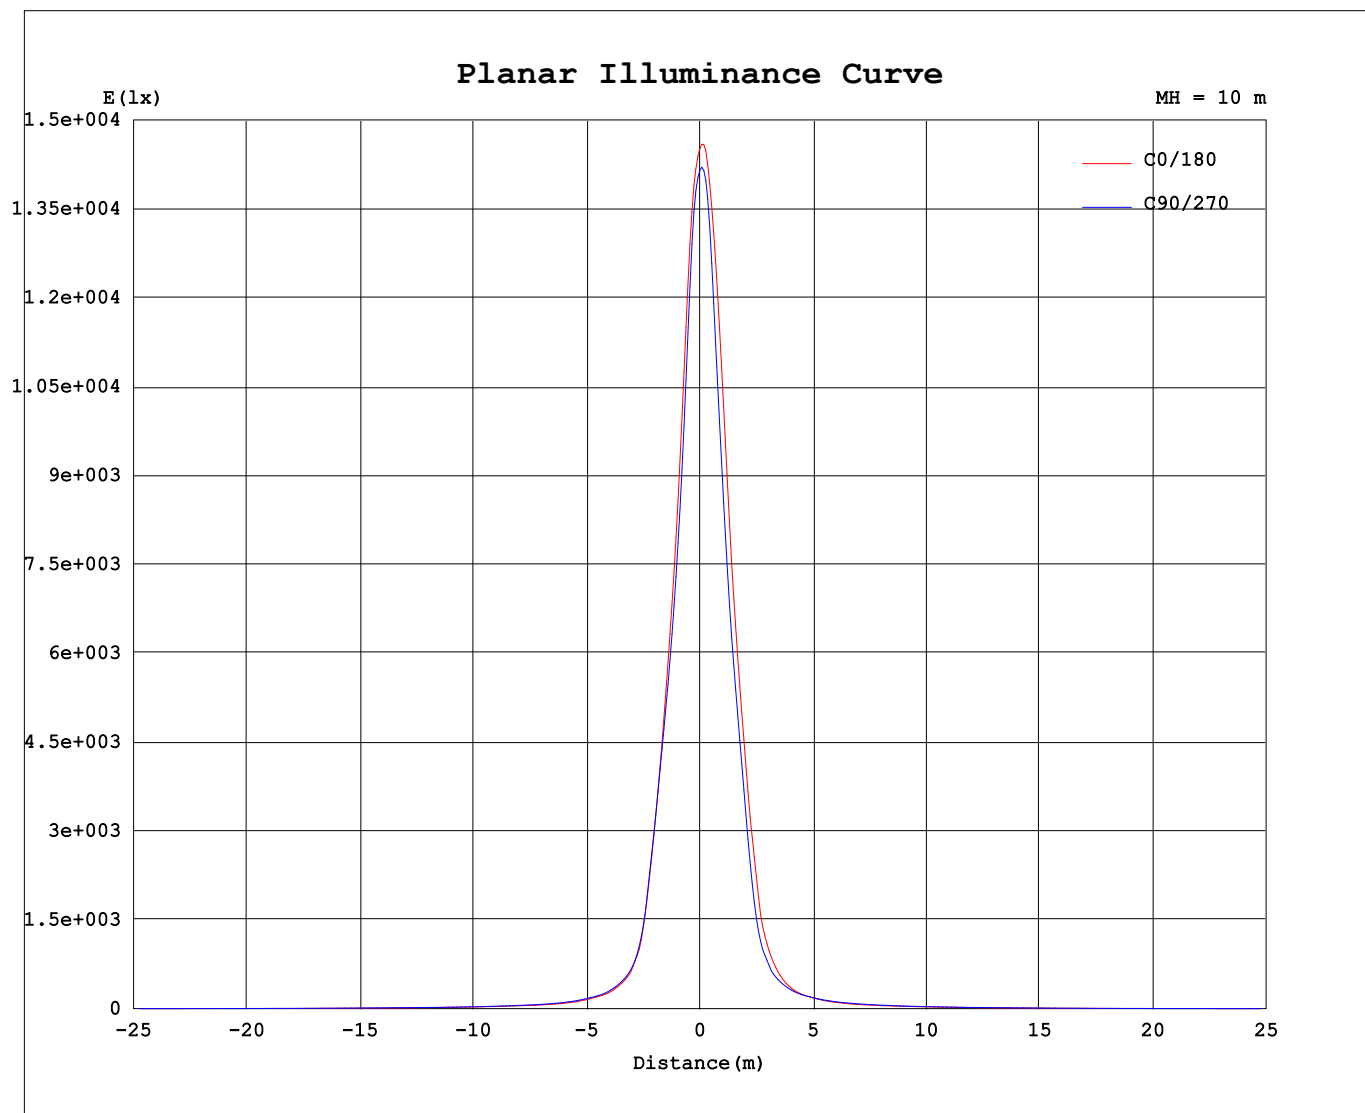

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZX
Test Date: 2023-12-01

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4621]
Remarks:

UNIT: X1000cd

C Range: 0 - 360DEG	γ Range: 0 - 90DEG
C Interval: 10.0DEG	γ Interval: 0.5DEG
Test Speed: HIGH	Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Temperature: 25.3°C	Humidity: 65.0%
Operators: ZZX	Test Distance: 26.000m [K=0.4621]
Test Date: 2023-12-01	Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4621]
Remarks:

```

LUMINOUS DISTRIBUTION INTENSITY DATA

UNIT: X1000cd

[illegible]

C Range: 0 - 360DEG
C Interval: 10.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: ZZX
Test Date: 2023-12-01

```

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4621]
Remarks:

```