


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:230.0V I:2.665A P:600.0W PF:0.979 Freq:50.00Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:93379.2x1 lm		
NAME: SP04-600-5770-F04003Z	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 155.63 lm/W			
MODEL	/	Imax (cd)	245987	S/MH (C0/180)	0.52
NOMINAL POWER (W)	/	LOR (%)	100.0	S/MH (C90/270)	0.52
RATED VOLTAGE (V)	/	TOTAL FLUX (lm)	93379	η UP,DN (C0-180)	0.0,50.0
NOMINAL FLUX (lm)	93379.2	CIE CLASS	DIRECT	η UP,DN (C180-360)	0.0,50.0
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.50
TEST VOLTAGE (V)	/	η down (%)	100.0	CIBSE SHR MAX	0.50

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

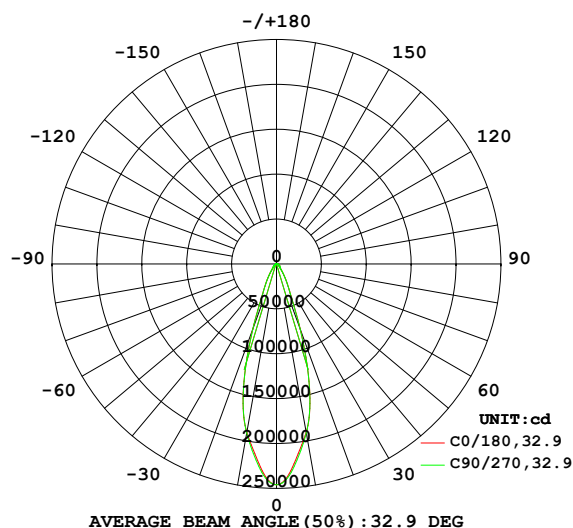

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

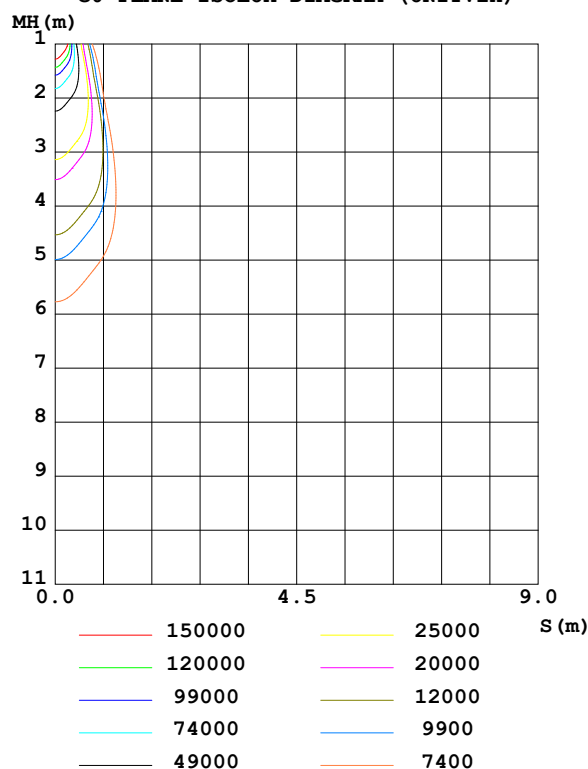

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:LYJ
Test Date:19 September 2022

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4548]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1906	1911	1913	1911	1906	1911	1913	1911	0- 10	20373	20373	21.8,21.8
20	775.4	760.1	769.3	760.1	775.4	760.1	769.3	760.1	10- 20	37525	57898	62,62
30	218.8	194.1	215.9	194.1	218.8	194.1	215.9	194.1	20- 30	17682	75580	80.9,80.9
40	75.85	64.93	74.61	64.93	75.85	64.93	74.61	64.93	30- 40	7597	83178	89.1,89.1
50	43.46	40.17	43.07	40.17	43.46	40.17	43.07	40.17	40- 50	4041	87219	93.4,93.4
60	27.15	27.34	27.34	27.34	27.15	27.34	27.34	27.34	50- 60	3043	90262	96.7,96.7
70	14.44	14.39	14.43	14.39	14.44	14.39	14.43	14.39	60- 70	2030	92291	98.8,98.8
80	4.116	4.033	4.119	4.033	4.116	4.033	4.119	4.033	70- 80	941.6	93233	99.8,99.8
90	0.0284	0.0258	0.0263	0.0258	0.0284	0.0258	0.0263	0.0258	80- 90	146.5	93379	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:X100cd									UNIT:lm		

Conical surface Flux(90deg): 85362 lm

%lum = 91.4%

%lamp = 91.4%

Conical surface Flux(120deg): 90262 lm


%lum = 96.7%

%lamp = 96.7%

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:LYJ
Test Date:19 September 2022

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4548]
Remarks:

LUMINANCE LIMITATION CURVES

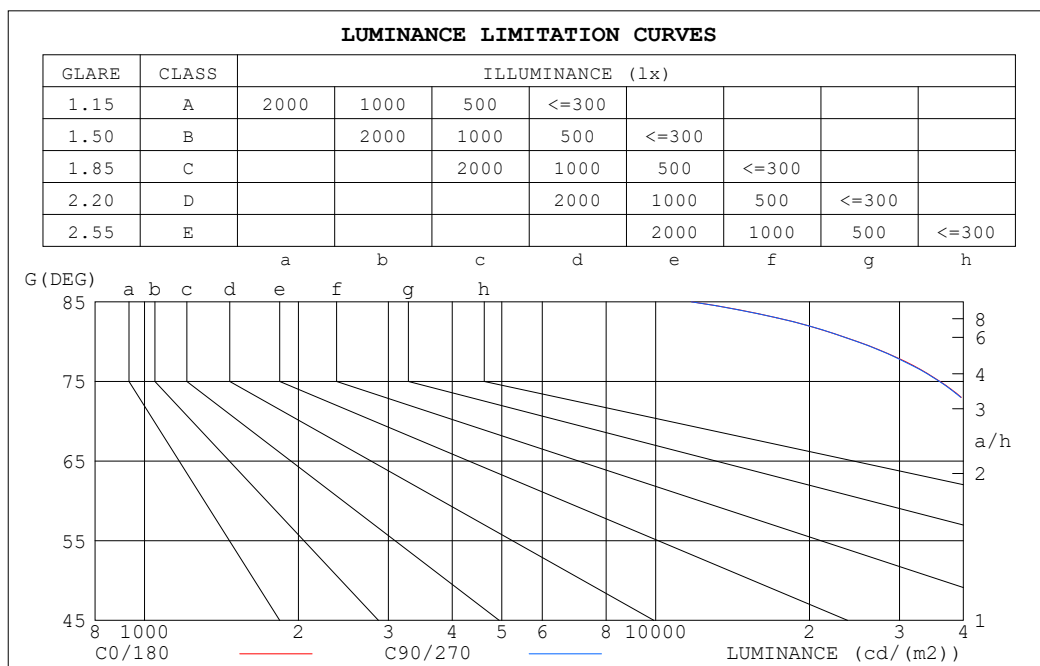

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	11764	11751
80	24826	24788
75	35998	35934
70	44226	44097
65	50728	50852
60	56879	57130
55	63378	62818
50	70809	70007
45	80441	78808


C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: LYJ
Test Date: 19 September 2022

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4548]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.11	1.09	1.07	1.09	1.07	1.05	1.05	1.03	1.02	1.01	.00	.99	.98	.97	.96	.94
2.0	1.04	1.00	.97	1.02	.99	.96	.99	.96	.94	.96	.94	.92	.93	.92	.90	.88
3.0	.98	.93	.90	.97	.92	.89	.94	.90	.87	.92	.89	.86	.89	.87	.85	.83
4.0	.93	.87	.84	.91	.87	.83	.89	.85	.82	.87	.84	.81	.86	.83	.80	.79
5.0	.88	.83	.79	.87	.82	.78	.85	.81	.78	.84	.80	.77	.82	.79	.76	.75
6.0	.84	.78	.74	.83	.78	.74	.81	.77	.74	.80	.76	.73	.79	.75	.73	.71
7.0	.80	.75	.71	.79	.74	.71	.78	.74	.70	.77	.73	.70	.76	.72	.70	.68
8.0	.76	.71	.68	.76	.71	.67	.75	.70	.67	.74	.70	.67	.73	.69	.67	.65
9.0	.73	.68	.65	.73	.68	.65	.72	.68	.64	.71	.67	.64	.70	.67	.64	.63
10.0	.71	.66	.62	.70	.65	.62	.69	.65	.62	.69	.65	.62	.68	.64	.62	.61

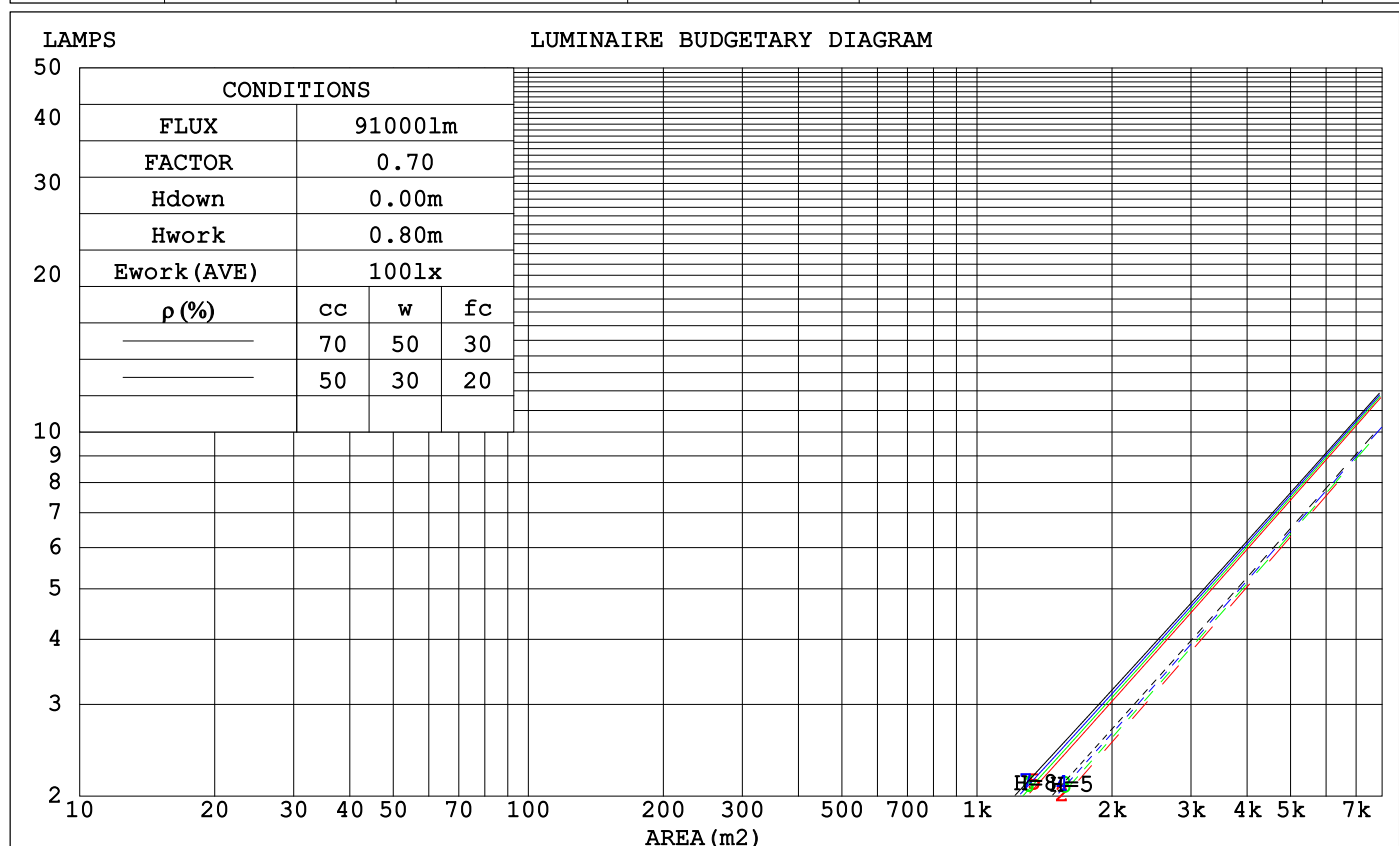

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature:25.3°C
 Operators:LYJ
 Test Date:19 September 2022

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
 Humidity:65.0%
 Test Distance:26.000m [K=0.4548]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)									
0.0																
1.0	.171	.097	.031	.165	.094	.030	.152	.087	.028	.141	.081	.026	.130	.075	.024	
2.0	.161	.088	.027	.156	.086	.026	.145	.081	.025	.136	.076	.024	.127	.072	.023	
3.0	.151	.081	.024	.147	.079	.024	.138	.075	.023	.129	.071	.022	.122	.067	.021	
4.0	.142	.074	.022	.138	.072	.021	.130	.069	.021	.123	.066	.020	.117	.063	.019	
5.0	.134	.068	.020	.130	.067	.019	.124	.064	.019	.117	.062	.018	.112	.060	.018	
6.0	.126	.063	.018	.123	.062	.018	.117	.060	.018	.112	.058	.017	.107	.056	.017	
7.0	.120	.059	.017	.117	.058	.017	.112	.057	.016	.107	.055	.016	.103	.053	.016	
8.0	.114	.056	.016	.111	.055	.015	.107	.053	.015	.103	.052	.015	.099	.051	.015	
9.0	.108	.052	.015	.106	.052	.015	.102	.051	.014	.098	.049	.014	.095	.048	.014	
10.0	.103	.050	.014	.101	.049	.014	.098	.048	.014	.095	.047	.013	.091	.046	.013	

ρ_{cc}	80%			70%			50%			30%			10%			0	
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.171	.157	.145	.146	.135	.125	.100	.093	.086	.058	.054	.050	.018	.017	.016		
2.0	.155	.133	.114	.133	.114	.098	.091	.079	.069	.052	.046	.040	.017	.015	.013		
3.0	.142	.113	.091	.121	.098	.079	.083	.068	.055	.048	.040	.033	.015	.013	.011		
4.0	.130	.099	.074	.112	.085	.065	.077	.059	.045	.045	.035	.027	.014	.011	.009		
5.0	.121	.087	.062	.104	.075	.054	.072	.052	.038	.041	.031	.022	.013	.010	.007		
6.0	.113	.077	.052	.097	.067	.045	.067	.047	.032	.039	.028	.019	.013	.009	.006		
7.0	.105	.069	.044	.091	.060	.038	.063	.042	.027	.036	.025	.016	.012	.008	.005		
8.0	.099	.063	.038	.085	.055	.033	.059	.038	.023	.034	.023	.014	.011	.007	.005		
9.0	.094	.057	.033	.081	.050	.029	.056	.035	.020	.033	.021	.012	.011	.007	.004		
10.0	.089	.053	.029	.077	.046	.025	.053	.032	.018	.031	.019	.011	.010	.006	.004		

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature:25.3°C
 Operators:LYJ
 Test Date:19 September 2022

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
 Humidity:65.0%
 Test Distance:26.000m [K=0.4548]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	21.4	22.4	21.8	22.8	23.1	21.4	22.4	21.8	22.7	23.1
3H	22.8	23.7	23.1	24.0	24.4	22.7	23.7	23.1	24.0	24.4
4H	23.2	24.0	23.6	24.4	24.8	23.1	24.0	23.5	24.3	24.7
6H	23.3	24.1	23.7	24.5	24.9	23.3	24.1	23.7	24.5	24.9
8H	23.3	24.1	23.8	24.5	24.9	23.3	24.0	23.7	24.4	24.9
12H	23.3	24.0	23.7	24.4	24.8	23.3	24.0	23.7	24.4	24.8
4H 2H	21.8	22.7	22.2	23.0	23.4	21.8	22.7	22.2	23.0	23.4
3H	23.3	24.0	23.8	24.5	24.9	23.3	24.0	23.7	24.4	24.8
4H	23.8	24.4	24.3	24.9	25.3	23.8	24.4	24.2	24.8	25.3
6H	24.1	24.6	24.5	25.0	25.5	24.0	24.6	24.5	25.0	25.5
8H	24.1	24.6	24.5	25.0	25.5	24.1	24.5	24.5	25.0	25.5
12H	24.0	24.5	24.5	25.0	25.4	24.0	24.5	24.5	24.9	25.4
8H 4H	23.9	24.4	24.4	24.9	25.3	23.9	24.4	24.4	24.8	25.3
6H	24.2	24.6	24.7	25.1	25.6	24.2	24.6	24.7	25.1	25.6
8H	24.2	24.6	24.8	25.1	25.6	24.2	24.6	24.8	25.1	25.6
12H	24.2	24.5	24.8	25.0	25.6	24.2	24.5	24.7	25.0	25.6
12H 4H	23.9	24.3	24.4	24.8	25.3	23.9	24.3	24.3	24.8	25.3
6H	24.2	24.5	24.7	25.0	25.5	24.2	24.5	24.7	25.0	25.5
8H	24.2	24.5	24.8	25.0	25.6	24.2	24.5	24.7	25.0	25.6
CIE190: 2010										

CIE190: 2010
Area: 0.0957 m2

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: LYJ
Test Date: 19 September 2022

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4548]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	85	78	74	84	78	74	83	77	74	70
0.80	92	86	82	92	86	82	90	85	81	77
1.00	97	91	87	96	91	87	95	91	86	82
1.25	101	96	92	100	95	91	98	94	91	86
1.50	104	99	95	103	98	95	101	97	94	89
2.00	107	103	99	106	102	98	103	100	97	91
2.50	109	105	102	108	104	101	104	101	99	93
3.00	111	107	104	109	106	103	106	103	101	94
4.00	113	110	108	111	108	106	107	105	104	96
5.00	115	112	110	112	110	108	108	107	105	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004						Suspended			SHRNOM = 1.25	

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators: LYJ
 Test Date: 19 September 2022

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
 Humidity: 65.0%
 Test Distance: 26.000m [K=0.4548]
 Remarks:


ISOCANDELA DIAGRAM

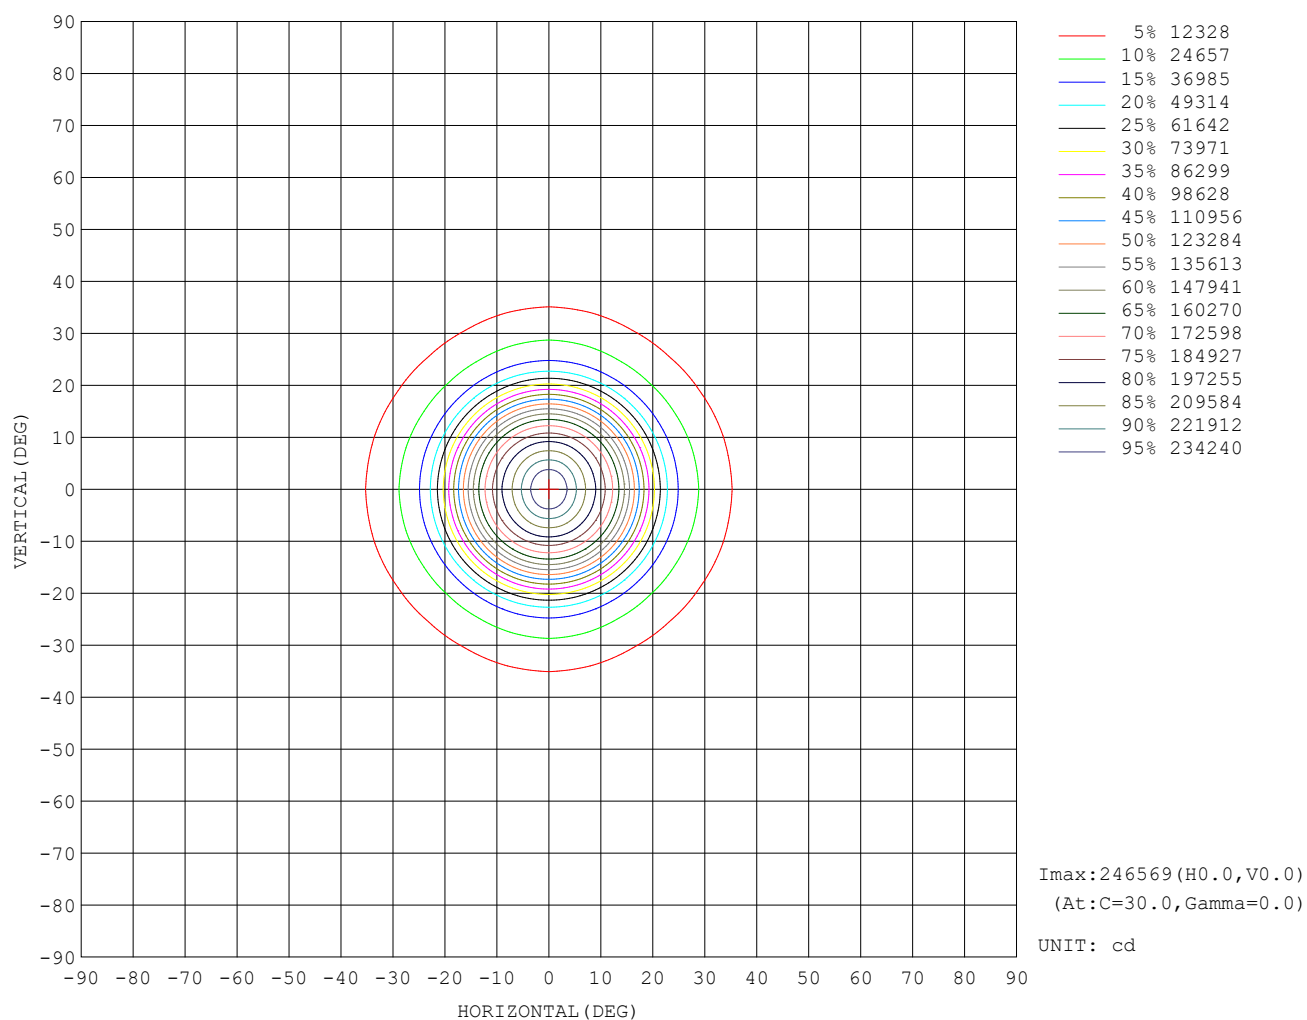

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:LYJ
Test Date:19 September 2022

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity:65.0%
Test Distance:26.000m [K=0.4548]
Remarks:

AAI Figure

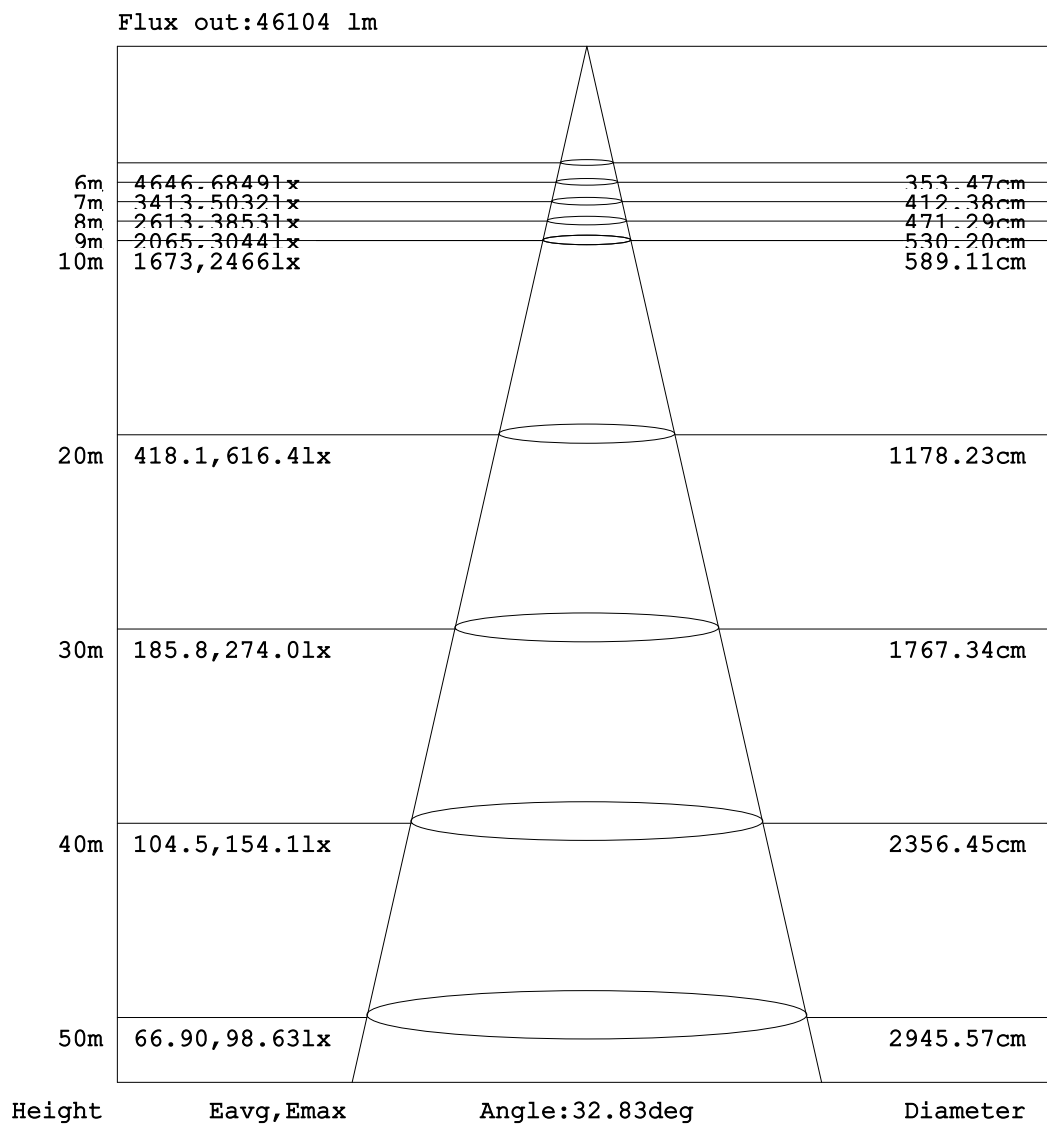

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG

C Interval: 15.0DEG

Test Speed: HIGH

Temperature:25.3°C

Operators:LYJ

Test Date:19 September 2022

γ Range: 0 - 90DEG

γ Interval: 0.5DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.465


Humidity:65.0%

Test Distance:26.000m [K=0.4548]

Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


ISOLUX DIAGRAM

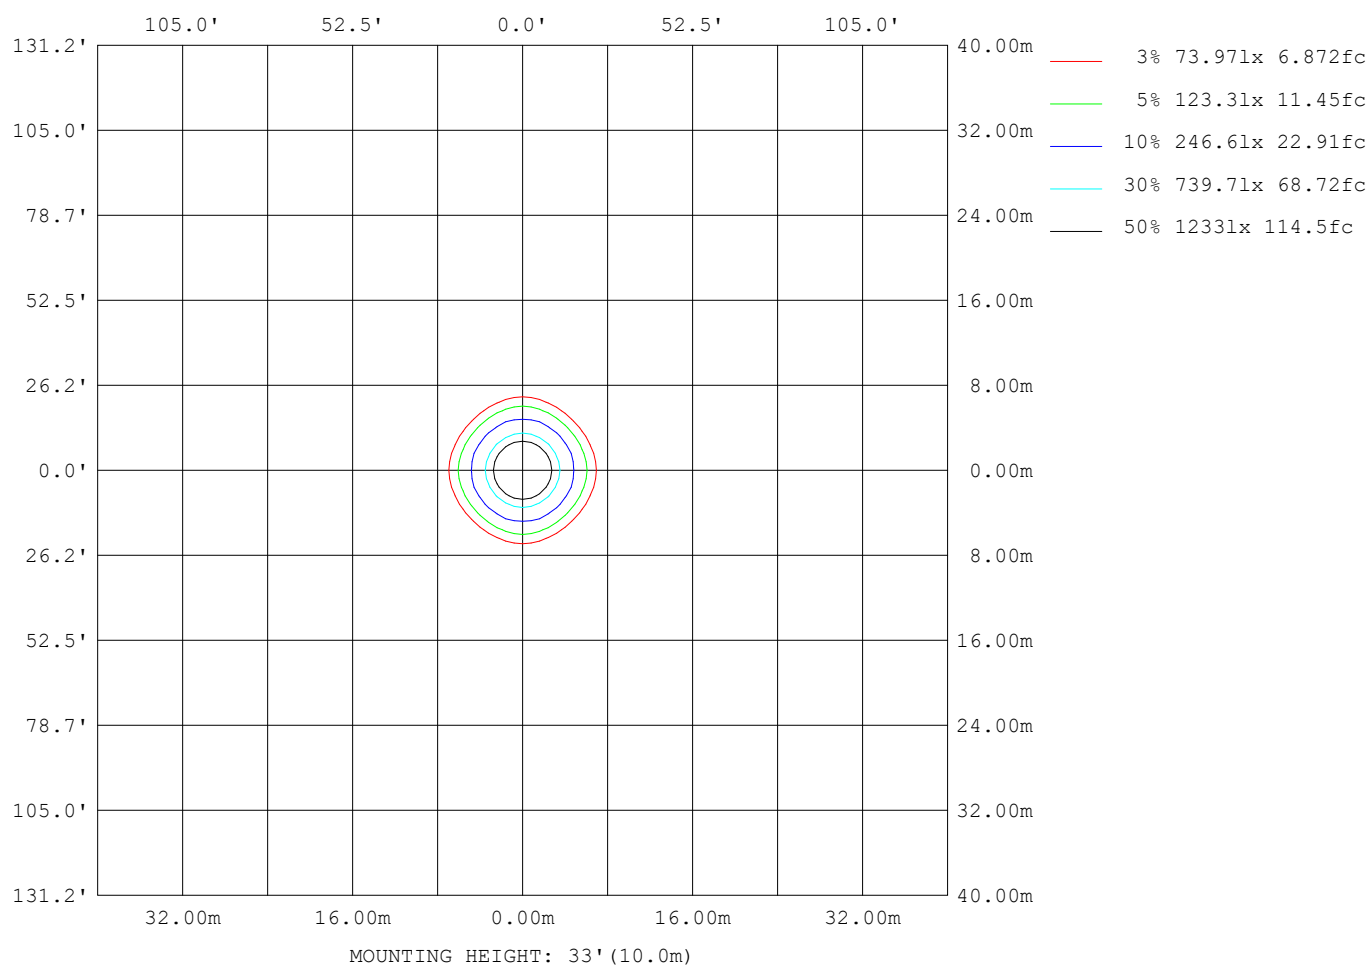

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: LYJ
Test Date: 19 September 2022

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4548]
Remarks:

Planar Illuminance Curve

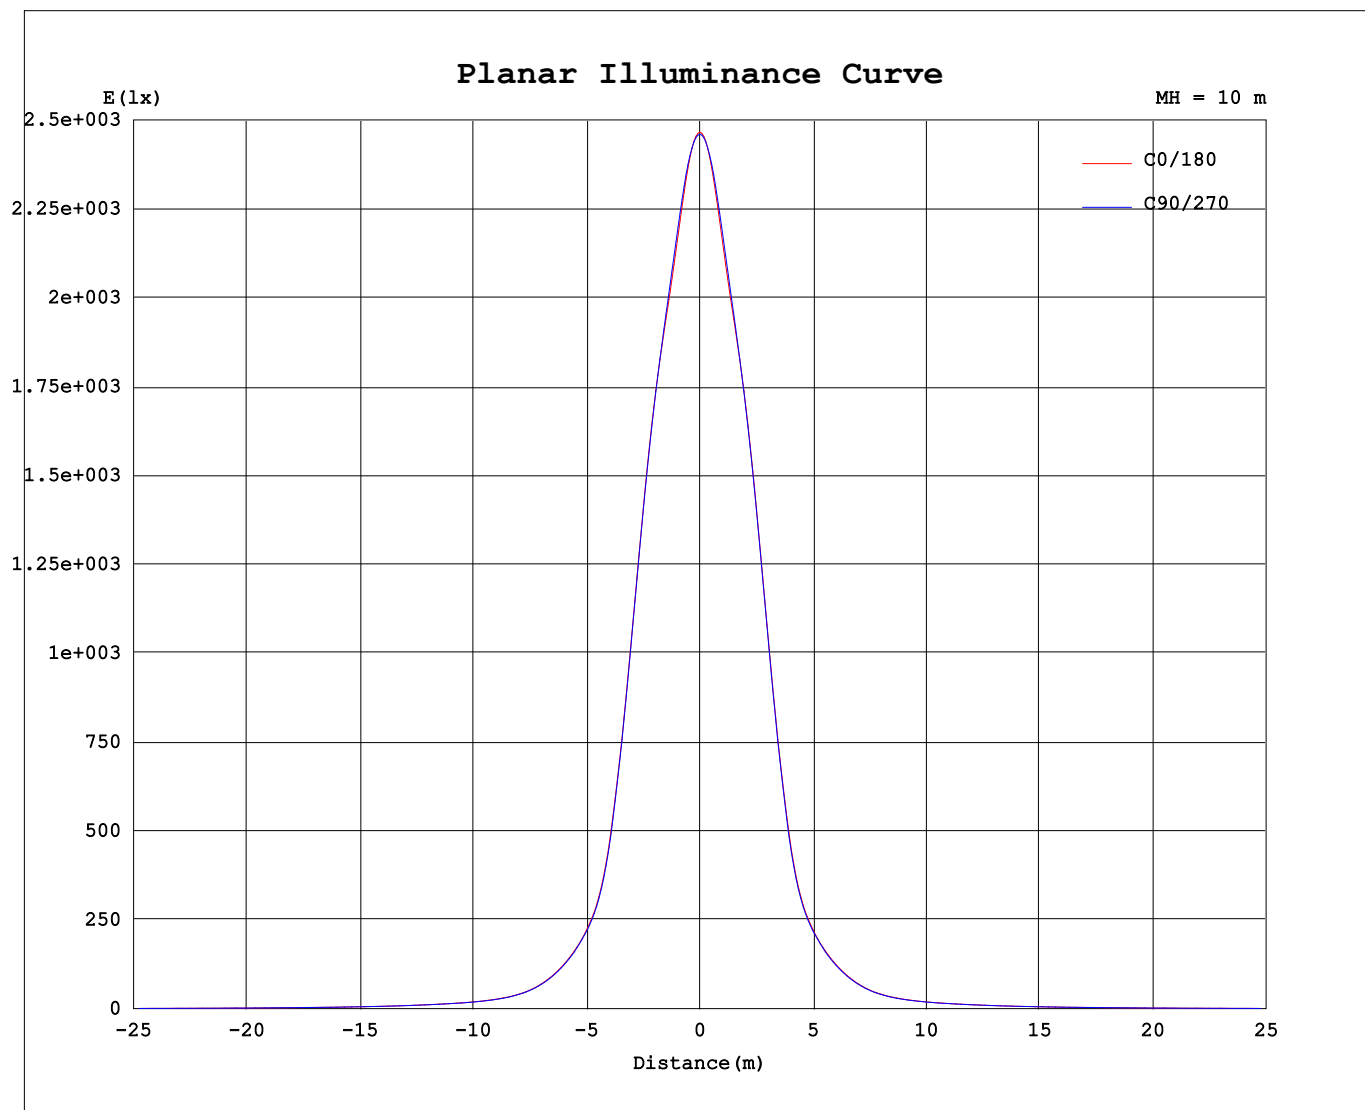

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: LYJ
Test Date: 19 September 2022

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.465
Humidity: 65.0%
Test Distance: 26.000m [K=0.4548]
Remarks: